


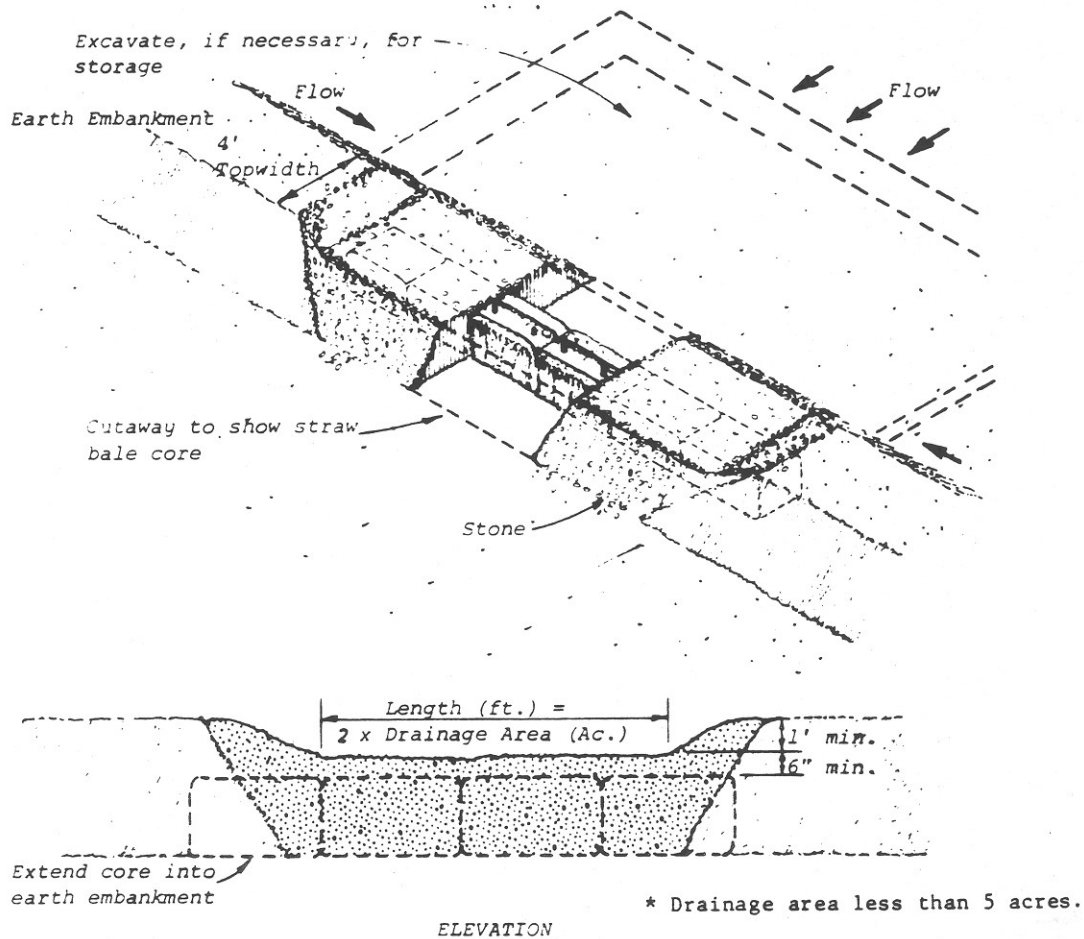

## GENERAL NOTES FOR TEMPORARY SEDIMENT TRAPS

1. THE DRAINAGE AREA FOR A SEDIMENT TRAP SHALL BE LESS THAN 5 ACRES.

THE SEDIMENT TRAP SHOULD BE LOCATED TO OBTAIN THE MAXIMUM STORAGE BENEFIT FROM THE TERRAIN, FOR EASE OF CLEANOUT OF THE TRAPPED SEDIMENT, AND TO MINIMIZE INTERFERENCE WITH CONSTRUCTION ACTIVITIES.

2. THE SURFACE AREA OF A SEDIMENT TRAP AS MEASURED AT THE ELEVATION OF THE CREST OF THE OUTLET SHALL BE AT LEAST 260 SQUARE FEET PER ACRE OF DRAINAGE AREA WITH A MINIMUM TRAP DEPTH OF 2 FEET. FOR DEEPER TRAPS ACCOMMODATING MORE SEDIMENT STORAGE, THE SURFACE AREA REQUIREMENT SHALL NOT BE DECREASED.

| Revision | By | Approved | Date |
|----------|----|----------|------|
|          |    |          |      |
|          |    |          |      |
|          |    |          |      |
|          |    |          |      |
|          |    |          |      |

**CITY OF OCEANSIDE**

**SEDIMENT TRAP**

*Ronald A. Beech*  
 CITY ENGINEER 12/2/92 Date  
**STANDARD**  
 DRAWING NO. **M-23**